




AC Services,  
 5 Avondale Ct, Mallow  
 Co. Cork, P51R92N  
 E Mail: Info@acservices.ie  
 Web: acservices.ie

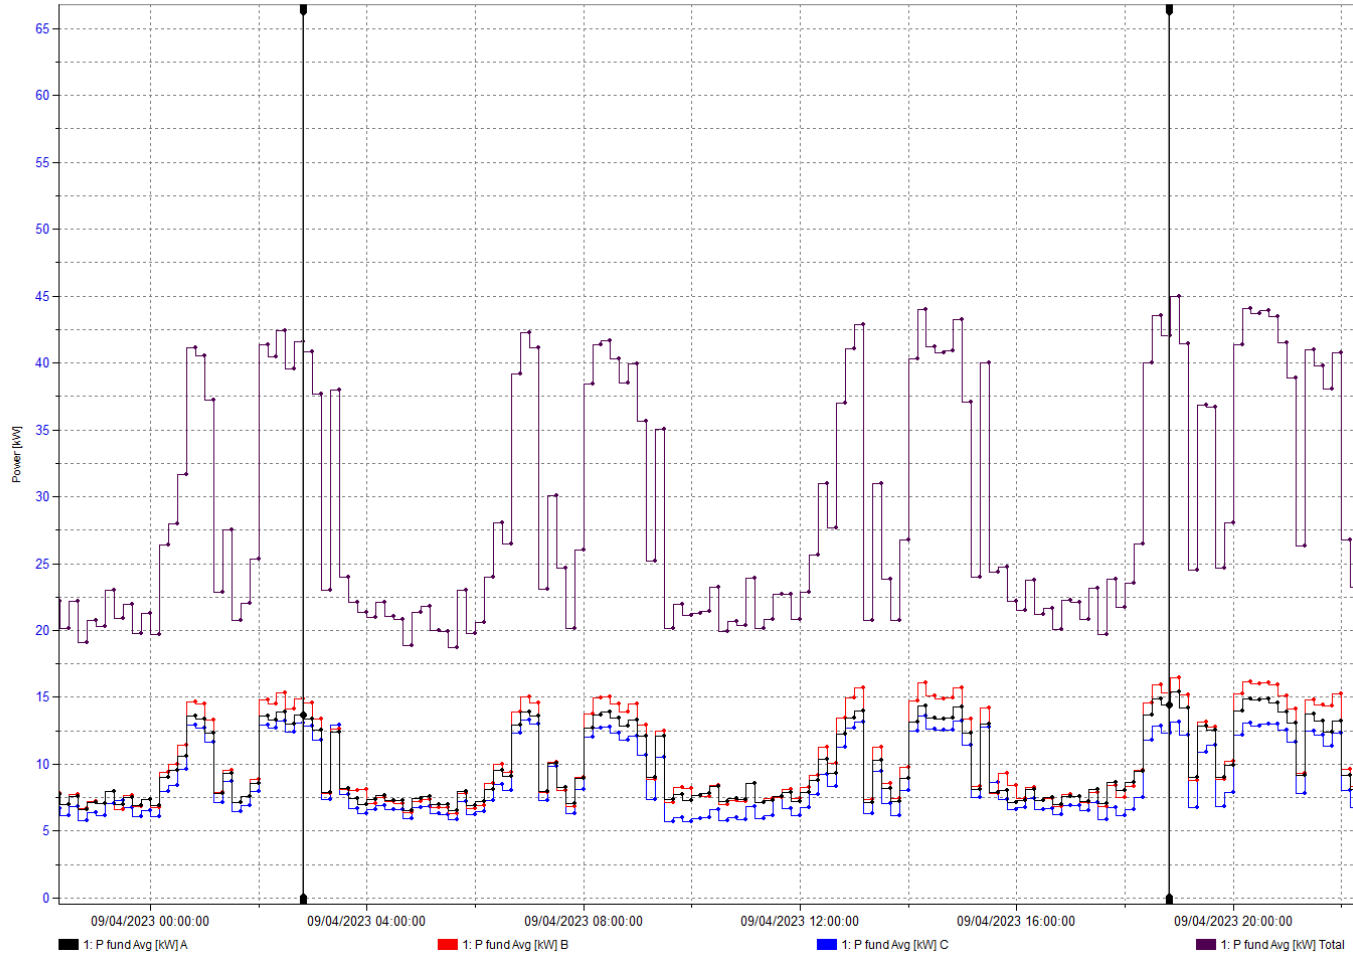

**Graph options**

**Session**

**TEXAS MAIN BOARD**

**Left scale options**

P fund [W]	S fund	Q fund
<input checked="" type="checkbox"/> A	<input type="checkbox"/> Max	<input type="checkbox"/> Min
<input checked="" type="checkbox"/> B	<input type="checkbox"/> Show Limit	
<input checked="" type="checkbox"/> C	0 W	
<input checked="" type="checkbox"/> Total		

**Right scale options**

**DPF [1]** **Aux**

<input type="checkbox"/> A	<input type="checkbox"/> Show Limit
<input type="checkbox"/> B	
<input type="checkbox"/> C	1
<input type="checkbox"/> Total	

**Time range**

1 Hour  
 1 Day  
 1 Week  
 Individual

Set time range

Begin: 30/03/2023 11:22:20  
 End: 19/04/2023 09:15:05

**Working hours**

Set working hours

Start: 08:00 Span: 08:00  
 Mon  Tue  Wed  Thu  Fri  Sat  Sun

**Cursor 1:**  
 1: P fund Avg [kW] A  
 13.679 kW  
 09/04/2023 02:49:39.987

**Cursor 2:**  
 1: P fund Avg [kW] A  
 14.410 kW  
 09/04/2023 18:49:42.064

**Delta:**  
 0.731 kW  
 16h 0m 2.076s



AC Services,  
 5 Avondale Ct, Mallow  
 Co. Cork, P51R92N  
 E Mail: Info@acservices.ie  
 Web: acservices.ie

TEXAS MAIN BOARD

Logging Information				
Study type:	Energy study	Topology:	3-ph Wye	
Start date:	30/03/2023 11:22:20	End date:	19/04/2023 09:15:05	
Duration:	19d 21h 52m 45s			
Averaging interval:	10min	Number of averaging intervals:	2868	

Voltage [V]	AN	BN	CN	N
Max	242.8 V 15/04/2023 01:00:00	249.2 V 17/04/2023 07:30:00	244.3 V 09/04/2023 00:30:00	
linear Avg	233.7 V	239.6 V	234.6 V	
Min	192.5 V 12/04/2023 15:20:00	208.9 V 13/04/2023 19:00:00	194.2 V 12/04/2023 15:20:00	

Current [A]	A	B	C	N
Max	218.9 A 19/04/2023 01:00:00	243.0 A 17/04/2023 07:30:00	293.3 A 17/04/2023 07:30:00	
linear Avg	52.9 A	55.5 A	51.1 A	
Min	12.8 A 05/04/2023 13:10:00	3.2 A 05/04/2023 13:10:00	1.3 A 05/04/2023 13:10:00	

Frequency [Hz]	AN	BN	CN	N
Max	50.19 Hz 12/04/2023 10:50:00			
linear Avg	50.00 Hz			
Min	49.86 Hz 03/04/2023 17:30:00			

V THD [%]	AN	BN	CN	N
Max	3.0 % 30/03/2023 12:50:00	4.3 % 17/04/2023 07:30:00	5.0 % 17/04/2023 07:30:00	
linear Avg	1.5 %	1.5 %	1.5 %	
Min	1.0 % 09/04/2023 04:30:00	1.0 % 16/04/2023 02:20:00	1.1 % 05/04/2023 04:40:00	

A THD [%]	A	B	C	N
Max	22.3 % 15/04/2023 03:20:00	41.3 % 05/04/2023 13:10:00	32.3 % 05/04/2023 13:10:00	
linear Avg	2.7 %	2.8 %	2.5 %	
Min	0.81 % 05/04/2023 02:10:00	0.72 % 05/04/2023 02:10:00	0.63 % 14/04/2023 14:20:00	

TEXAS MAIN BOARD

Logging Information				
Study type:	Energy study	Topology:	3-ph Wye	Cost: 0.2€/kWh, fwd; 0€/kWh, rev
Start date:	30/03/2023 11:22:20	End date:	19/04/2023 09:15:05	
Duration:	19d 21h 52m 45s			
Demand interval:	15min	Number of demand intervals:	1913	* ... series contained partial intervals that have been discarded.

Cost of Energy				
Active energy, forward	14.618 MWh	<input checked="" type="radio"/> standard <input type="radio"/> advanced Total energy cost <b>€2,923.68f</b>		
Active energy, reverse	0.000 MWh			
Total active energy	14.618 MWh			
Max. demand	52.056* kW 05/04/2023 03:00:00			